

362PDS125-18-P (70ksi, G40EQ, Punched)

3-5/8" ProSTUD® 20 (18mil) Drywall Stud with PDS125 (1-1/4") flange

Coating: G40EQ

Color Code: Brown

Geometric Properties

Web depth: 3.625 in

Flange width: 1.250 in

Stiffening lip: 0.325 in

Design Thickness: 0.0190 in

Minimum thickness: 0.0181 in

Yield strength, Fy: 70 ksi

Gross Section Properties of Full Section, Strong Axis

| | |
|----------------------------------|-----------------------|
| Cross sectional area (A) | 0.126 in ² |
| Member weight per foot of length | 0.428 lb/ft |
| Moment of inertia (Ix) | 0.254 in ⁴ |
| Radius of gyration (Rx) | 1.421 in |
| Gross moment of inertia (Iy) | 0.026 in ⁴ |
| Gross radius of gyration (Ry) | 0.456 in |

Effective Section Properties, Strong Axis

| | |
|--|-----------------------|
| Effective Area (Ae) | 0.044 in ² |
| Moment of inertia for deflection (Ixe) | 0.234 in ⁴ |
| Section modulus (Sxe) | 0.074 in ³ |
| Allowable bending moment (Ma) | 3,102 in-lbs |
| Allowable shear force in web (Unpunched section) (Vag) | 174 lb |
| Allowable shear force in web (Punched section) (Vanet) | 170 lb |

Torsional Properties

| | |
|---|------------------------|
| St. Venant torsional constant (J x 1000) | 0.0151 in ⁴ |
| Warping constant (Cw) | 0.070 in ⁶ |
| Distance from shear center to neutral axis (Xo) | -0.884 in |
| Radii of gyration (Ro) | 1.734 in |
| Torsional flexural constant (Beta) | 0.740 |
| Unbraced length (Lu) | 24.3 in |


- Effective properties incorporate the strength increase from the cold work of forming as applicable per AISI A3.3.2 of AISI S100-16 (2020) w/S2-20.
- Tabulated gross properties, including torsional properties, are based on full-unreduced cross section of the studs, away from punchouts.
- For deflection calculations, use the effective moment of inertia.
- Allowable moment includes cold work of forming.
- Allowable moment is taken as the lowest value based on local or distortional buckling. Distortional buckling strength is based on a k-phi = 0.

Code Approvals & Performance Standards

- **AISI S100-16 (2020) w/S2-20** North American Specification for the Design of Cold-Formed Steel Structural Members
- **AISI S220-20** North American Standard for Cold-Formed Steel Framing - Nonstructural Members
 - (Compliant to ASTM C645, but IBC replaced with AISI S220 in IBC 2015)
 - Section A3 Material - Chemical & mechanical requirements (Referencing ASTM A1003/A1003M)
 - Section A4 Corrosion Protection (Referencing ASTM A653/A653M)
 - Section A5 Products - Thickness, shapes, tolerances, identification
 - Section C Installation - (Referencing ASTM C754)
- **AISI S202-20** Code of Standard Practice for Cold-Formed Steel Structural Framing
 - Section F3 Delivery, Handling and Storage of Materials
- **ASTM E72** Standard Test Methods of Conducting Strength Tests of Panels for Building Construction
- **ASTM E90** Standard Test Method for Laboratory Measurement of Airborne Sound Transmission Loss of Building Partitions and Elements
- **ASTM E119** Standard Test Methods for Fire Tests of Building Construction and Materials
- **IBC 2021** International Building Code
- **Intertek CCRR-0207** Non-Structural Metal Framing
- **LA RR #26019** City of Los Angeles ProSTUD Research Report
- **NYC OTRC** ProSTUD Approval Letter
- **UL Designs 263** "Fire Tests of Building Construction and Materials"
- **UL File Number R26512** Full list of ProSTUD and ProTRAK UL design assemblies
- **SDS For ASTM A1003 Steel Framing Products** For Interior Framing, Exterior Framing and Clips/Accessories



- Embossments in web are only placed on sections 2-1/2" and wider.
- U.S. Patent No. 9,010,070



Non-Structural Punchout

East Coast / Central punch spacing:

Center of punchouts are
12" from lead end, then 48" o.c.

West Coast punch spacing:

Center of punchouts are
24" from lead end, then 24" o.c.

Center of tail end punchout not less
than 12" from end of stud.

If custom punchout patterns are required,
contact ClarkDietrich Sales or local plant for requests.

Sustainability Credits For more details and LEED letters contact Technical Services at 888-437-3244 or visit clarkdietrich.com/LEED.

- **LEED v4.1 MR Credit:** Environmental Product Declarations: EPD (1 point) - Sourcing of Raw Materials (up to 2 points) - Material Ingredients (1 point) - Construction and Demolition Waste Management (up to 2 points)
- **LEED v4 MR Credit:** Building Product Disclosure and Optimization: EPD (1 point) - Sourcing of Raw Materials (1 point) - Material Ingredients (1 point) - Construction and Demolition Waste Management (up to 2 points) - Innovation Credit (up to 2 points).


3-5/8" ProSTUD 20 (18mil 70ksi) Drywall Stud - Head-of-Wall (HOW) Composite Limiting Heights

With 30mil 2-1/2" Leg MaxTRAK + (1 layer) 5/8" Type X Gypsum Board each side

| Spacing (inches) | 5 psf | | | 7.5 psf | | | 10 psf | | |
|---------------------|---------|--------|--------|----------|--------|--------|----------|---------|--------|
| | L/120 | L/240 | L/360 | L/120 | L/240 | L/360 | L/120 | L/240 | L/360 |
| 12 | 21'-2" | 17'-8" | 15'-5" | 18'-6" | 15'-6" | 13'-5" | 16'-10" | 14'-1" | 12'-3" |
| 16 | 19'-11" | 16'-8" | 14'-6" | 17'-5" | 14'-7" | 12'-8" | 15'-10" | 13'-3" | 11'-3" |
| 24 | 18'-0" | 15'-0" | 13'-0" | 15'-9" f | 13'-2" | 11'-2" | 13'-7" f | 11'-11" | 9'-9" |

Allowable HOW composite limiting heights were tested in accordance with AISI S916 and ICC-ES AC86.

- The tests were modified from the standards with the tracks fastened to the test fixture such that the wall stiffness included the track deformation.
- In accordance with current building codes and AISI design standards, the 1/3 Stress Increase for strength was not used.
- The composite limiting heights provided in the tables are based on a single layer of 5/8" Type X Gypsum Board from the following manufacturers: American, CertainTeed, Georgia Pacific, Continental, National, PABCO, and USG.
- The gypsum board must be applied full height in the vertical orientation to each stud flange and installed in accordance with ASTM C754 using minimum No. 6 Type S Drywall screws spaced as listed below:
 - Sheathing screws spaced a maximum of 16 in on-center to framing members (including bottom track) when studs spaced at 16 in or 12 in on-center.
 - Sheathing screws spaced a maximum of 12 in on-center to framing members (including bottom track) when studs spaced at 24 in on-center.
- #8 wafer head screws shall be used for attaching the stud to 30mil 2-1/2" Leg MaxTRAK (as top track) adhering to details below:
 - Stud to track connection must be installed as depicted in figure with a maximum gap of 7/8" between the web of the MaxTRAK and end of stud.
 - Slots in the MaxTRAK Legs allows for a total vertical movement of 1-1/2" (+/- 3/4") with screw centered in slots.
 - Screws shall be placed in each flange of the stud at a minimum of 3/8" from the end of the stud.
 - To permit head of wall deflection, gypsum board must not be fastened directly to the MaxTRAK.
- No fasteners are required for attaching the stud to the bottom track except as detailed in ASTM C
- f: Adjacent to the height value indicates that flexural stress controls the allowable wall height.

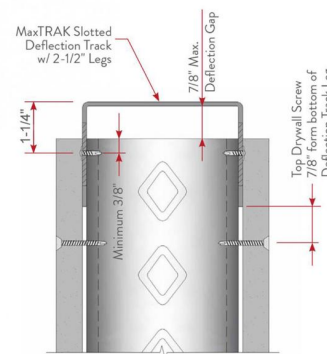


3-5/8" ProSTUD 20 (18mil 70ksi) Drywall Stud - Head-of-Wall (HOW) Composite Limiting Heights

With 30mil 2-1/2" Deep Leg Deflection Track + (1 layer) 5/8" Type X Gypsum Board each side

| Spacing (inches) | 5 psf | | | 7.5 psf | | | 10 psf | | |
|---------------------|---------|---------|--------|---------|--------|--------|----------|---------|--------|
| | L/120 | L/240 | L/360 | L/120 | L/240 | L/360 | L/120 | L/240 | L/360 |
| 12 | 21'-2" | 17'-8" | 15'-5" | 18'-6" | 15'-6" | 13'-5" | 16'-10" | 14'-1" | 12'-3" |
| 16 | 19'-11" | 16'-8" | 14'-6" | 17'-5" | 14'-7" | 12'-8" | 15'-10" | 13'-3" | 11'-3" |
| 24 | 18'-0" | 14'-11" | 13'-0" | 15'-9" | 13'-1" | 11'-1" | 13'-7" f | 11'-10" | 9'-9" |

Allowable HOW composite limiting heights were tested in accordance with AISI S916 and ICC-ES AC86.

- The tests were modified from the standards with the tracks fastened to the test fixture such that the wall stiffness included the track deformation.
- In accordance with current building codes and AISI design standards, the 1/3 Stress Increase for strength was not used.
- The composite limiting heights provided in the tables are based on a single layer of 5/8" Type X Gypsum Board from the following manufacturers: American, CertainTeed, Georgia Pacific, Continental, National, PABCO, and USG.
- The gypsum board must be applied full height in the vertical orientation to each stud flange and installed in accordance with ASTM C754 using minimum No. 6 Type S Drywall screws spaced as listed below:
 - Sheathing screws spaced a maximum of 16 in on-center to framing members (including bottom track) when studs spaced at 16 in or 12 in on-center.
 - Sheathing screws spaced a maximum of 12 in on-center to framing members (including bottom track) when studs spaced at 24 in on-center.
- No fasteners are required for attaching the stud to the Deflection Track at the top except as detailed in ASTM C754:
 - Stud to track connection must be installed as depicted in figure with a maximum gap of 7/8" between the web of the Deflection Track and end of stud.
 - To permit head of wall deflection, gypsum board must not be fastened directly to the Deflection Track.
- No fasteners are required for attaching the stud to the bottom track except as detailed in ASTM C754.
- A Spazzer Spacing Bar (or bridging & bracing) shall be installed in the punchouts immediately adjacent to the top Deflection Track to hold studs in place.
- f: Adjacent to the height value indicates that flexural stress controls the allowable wall height

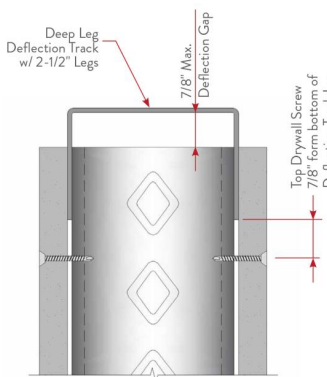

3-5/8" ProSTUD 20 (18mil 70ksi) Drywall Stud - FULL COMPOSITE Limiting Heights (AC86-2019)
With 1-1/4" leg non-deflection track + (1 layer) 5/8" Type X Gypsum Board each side

| Spacing (inches) | 5 psf | | | 7.5 psf | | | 10 psf | | |
|---------------------|--------|---------|--------|-----------|---------|--------|----------|--------|--------|
| | L/120 | L/240 | L/360 | L/120 | L/240 | L/360 | L/120 | L/240 | L/360 |
| 12 | 22'-0" | 18'-2" | 15'-8" | 19'-3" | 15'-10" | 13'-8" | 17'-6" | 14'-5" | 12'-5" |
| 16 | 20'-6" | 16'-10" | 14'-7" | 17'-11" | 14'-9" | 12'-9" | 16'-3" | 13'-5" | 11'-6" |
| 24 | 18'-4" | 15'-1" | 13'-0" | 15'-11" f | 13'-2" | 11'-4" | 13'-9" f | 12'-0" | 10'-1" |

Allowable composite limiting heights were tested in accordance with AISI S916 and ICC-ES AC86.

- Additional composite wall testing and analysis requirements of the SFIA Code Compliance Certification Program were also observed.
- In accordance with current building codes and AISI design standards, the 1/3 Stress Increase for strength was not used.
- The composite limiting heights provided in the tables are based on a single layer of 5/8" Type X gypsum board from the following manufacturers: American, CertainTeed, Georgia Pacific, Continental, National, PABCO, and USG.
- The gypsum board must be applied full height in the vertical orientation to each stud flange and installed in accordance with ASTM C754 using minimum No. 6 Type S Drywall screws spaced as listed below:
 - Screws spaced a maximum of 16 in on-center to framing members (including top & bottom track) spaced at 16 in or 12 in on-center.
 - Screws spaced a maximum of 12 in on-center to framing members (including top & bottom track) spaced at 24 in on-center.
- No fasteners are required for attaching the stud to the track except as detailed in ASTM C754.
- Stud end bearing must be a minimum of 1 inch.
- f: Adjacent to the height value indicates that flexural stress controls the allowable wall height.
- s: Adjacent to the height value indicates that shear/end reaction controls the allowable wall height.

3-5/8" ProSTUD 20 (18mil 70ksi) Drywall Stud - NON-COMPOSITE Limiting Heights (FULLY BRACED)

| Spacing (inches) | 5 psf | | | 7.5 psf | | | 10 psf | | |
|---------------------|--------|--------|--------|---------|--------|--------|--------|--------|--------|
| | L/120 | L/240 | L/360 | L/120 | L/240 | L/360 | L/120 | L/240 | L/360 |
| 12 | 18'-4" | 14'-6" | 12'-8" | 16'-0" | 12'-8" | 11'-1" | 14'-5" | 11'-6" | 10'-1" |
| 16 | 16'-8" | 13'-2" | 11'-6" | 14'-5" | 11'-6" | 10'-1" | 12'-5" | 10'-6" | 9'-2" |
| 24 | 14'-5" | 11'-6" | 10'-1" | 11'-9" | 10'-1" | 8'-10" | 10'-2" | 9'-2" | 8'-0" |

- Heights are based on AISI S100, North American Specification, and AISI S220, North American Standard for Cold-Formed Steel Framing - Nonstructural Members, using steel properties alone.
- Above listed Non-Composite Limiting Heights are applicable when the unbraced length is less than or equal to L_u .
- Heights are limited by moment, deflection, shear, and web crippling (assuming 1" end reaction bearing).

3-5/8" ProSTUD 20 (18mil 70ksi) Drywall Stud - NON-COMPOSITE Limiting Heights (BRACED at 48" o.c.)

| Spacing (inches) | 5 psf | | | 7.5 psf | | | 10 psf | | |
|---------------------|--------|--------|--------|---------|--------|--------|--------|--------|--------|
| | L/120 | L/240 | L/360 | L/120 | L/240 | L/360 | L/120 | L/240 | L/360 |
| 12 | 15'-2" | 14'-6" | 12'-8" | 12'-5" | 12'-5" | 11'-1" | 10'-9" | 10'-9" | 10'-1" |
| 16 | 13'-2" | 13'-2" | 11'-6" | 10'-9" | 10'-9" | 10'-1" | 9'-4" | 9'-4" | 9'-2" |
| 24 | 10'-9" | 10'-9" | 10'-1" | 8'-9" | 8'-9" | 8'-9" | 7'-7" | 7'-7" | 7'-7" |

- Heights are based on AISI S100, North American Specification, and AISI S220, North American Standard for Cold-Formed Steel Framing - Nonstructural Members, using steel properties alone.
- Above listed Non-Composite Limiting Heights are based on discreet stud bracing at 4 ft o.c.
- Heights are limited by moment, deflection, shear, and web crippling (assuming 1" end reaction bearing).