

**Product category:** (TLE) TRAKLOC Elevator Stud  
**Product name:** 362TLE125-24 57ksi G40 - Punched  
 3-5/8" TRAKLOC Stud 24 mils (20ga EQ)  
 Coating: G40  
 Color coding: Pink

### Geometric Properties

Web depth	3.625 in	Weight	0.539 lb/ft
Flange width	1.250 in	Punchout width	1.500 in
Stiffening lip	0.288 in	Punchout length	4.000 in
Design thickness	0.0250 in	Minimum thickness	0.0238 in
Yield stress, Fy	57 ksi		

### Gross Section Properties of Full Section, Strong Axis

Cross sectional area (A)	0.158 in <sup>2</sup>
Moment of inertia (Ix)	0.306 in <sup>4</sup>
Radius of gyration (Rx)	1.390 in
Gross moment of inertia (Iy)	0.029 in <sup>4</sup>
Gross radius of gyration (Ry)	0.425 in

### Effective Section Properties, Strong Axis

Effective area (Ae)	0.066 in <sup>2</sup>
Moment of inertia for deflection (Ixe)	0.281 in <sup>4</sup>
Section modulus (Sxe)	0.104 in <sup>3</sup>
Allowable bending moment - Local buckling (Mal)	3562 in-lbs
Allowable bending moment - Distortional buckling (Mad)	3520 in-lbs
Allowable shear force in web (Unpunched) (Vag)	408 lb
Allowable shear force in web (Punched) (Vanet)	288 lb

### Torsional Properties

St. Venant torsion constant (J x 1000)	0.0330 in <sup>4</sup>
Warping constant (Cw)	0.076 in <sup>6</sup>
Distance from shear center to neutral axis (Xo)	-0.817 in
Radii of gyration (Ro)	1.667 in
Torsional flexural constant (Beta)	0.760

Stud/track end reaction (Rx)	107 lbs
Unbraced Length (Lu)	22.4 in

### Notes:


- Calculated properties are based on AISI S100-07 w/ S2-10 Supplement and AISI S100-12, North American Specification for Design of Cold-Formed Steel Structural Members.
- Gross and torsional properties are based on full-unreduced cross section of the studs, away from punch-outs.
- The distortional buckling moment (Mad) does not consider the beneficial effect of sheathing to rotational stiffness.
- For deflection calculations, use the effective moment of inertia.
- Stud/Track End Reaction (Rx) is the maximum end reaction (web crippling) capacity based on a minimum bearing length of 1 inch.
- The minimum overlap of the TSO (Outer Stud) and TSE (Inner Stud) must be minimum 11 inches and for the non-composite wall configuration must be connected with a minimum of (4) #8 x 9/16" long wafer head screws complying with ASTM C1513.
- East Coast Punch Pattern: Center of knockouts are 12" from the leading edge then 48" o.c.
- West Coast Punch Pattern: Center of knockouts are 24" from the leading edge then 24" o.c.

**Sustainability Credits** For more details and LEED letters contact Technical Services at 888-437-3244 or visit [clarkdietrich.com/LEED](http://clarkdietrich.com/LEED).

**LEED v4.1 MR Credit:** Environmental Product Declarations: EPD (1 point) - Sourcing of Raw Materials (up to 2 points) - Material Ingredients (1 point) - Construction and Demolition Waste Management (up to 2 points)

**LEED v4 MR Credit:** Building Product Disclosure and Optimization: EPD (1 point) - Sourcing of Raw Materials (1 point) - Material Ingredients (1 point) - Construction and Demolition Waste Management (up to 2 points) - Innovation Credit (up to 2 points).

### 09.22.16 (Non-Structural Metal Framing)

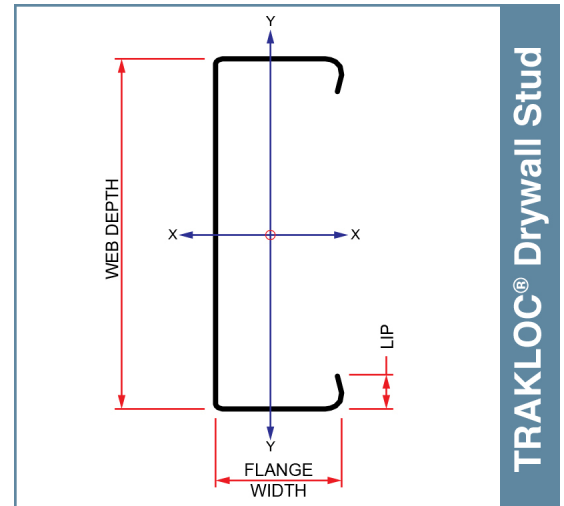

### ASTM & Code Standards:

- AISI-NASPEC 2007 w/S2-10
- Meets or exceeds ASTM C645
- SDS & Product Certification Information available at [www.clarkdietrich.com](http://www.clarkdietrich.com)



### Project Information

Name:  
Address:

### Contractor Information

Name:  
Contact:  
Phone:  
Fax:

### Architect Information

Name:  
Contact:  
Phone:  
Fax:

**Product category:** (TLE) TRAKLOC Elevator Stud  
**Product name:** 362TLE125-24 57ksi G40 - Punched  
 3-5/8" TRAKLOC Stud 24 mils (20ga EQ)

### 3-5/8" TRAKLOC Stud 24 mils (20ga EQ) Drywall Stud - COMPOSITE Limiting Heights (AC86-2012)

#### (1 layer) 5/8" Type X Gypsum Board

Spacing (inches)	5 psf			7.5 psf			10 psf		
	L/120	L/240	L/360	L/120	L/240	L/360	L/120	L/240	L/360
12	22'-6"	17'-10"	15'-7"	19'-8"	15'-7"	13'-7"	17'-10"	14'-2"	12'-5"
16	20'-5"	16'-3"	14'-2"	17'-10"	14'-2"	12'-5"	16'-3"	12'-10"	11'-1"
24	17'-10"	14'-2"	12'-5"	15'-7"	12'-5"	10'-7"	14'-2"	11'-1"	9'-5"

Composite Table Notes:


- Allowable composite limiting heights were determined in accordance with ICC-ES AC86-2012.
- Additional composite wall testing and analysis requirements of the SFIA Code Compliance Certification Program were observed.
- In accordance with current building codes and AISI design standards, the 1/3 Stress Increase for strength was not used.
- The composite limiting heights provided in the tables are based on a single layer of 5/8" Type X Gypsum Board complying with ASTM C1396 and from the following manufacturers: American Gypsum, CertainTeed, Georgia Pacific, Continental, National Gypsum or USG.
- The gypsum board must be applied full height in the vertical orientation to each stud flange and installed in accordance with ASTM C754 using minimum No. 6 Type S fine thread Drywall bugle head screws spaced as listed below:
  - Screws spaced a maximum of 12 inch on-center studs.
  - Screws spaced 16 inch on-center to the top and bottom track.
- No fasteners are required for attaching the stud to the track except as detailed in ASTM C754.
- Stud end bearing must be a minimum of 1 inch.
- The minimum overlap of the TSO (Outer Stud) and TSE (Inner Stud) must be 11 inches.
- f: Adjacent to the height value indicates that flexural stress controls the allowable wall height.
- s: Adjacent to the height value indicates that shear/end reaction controls the allowable wall height.

### 3-5/8" TRAKLOC Stud 24 mils (20ga EQ) Drywall Stud - NON-COMPOSITE Limiting Heights (FULLY BRACED)

Spacing (inches)	5 psf			7.5 psf			10 psf		
	L/120	L/240	L/360	L/120	L/240	L/360	L/120	L/240	L/360
12	19'-5"	15'-5"	13'-6"	17'-8"	15'-2"	13'-3"	15'-4"	13'-10"	12'-1"
16	17'-8"	14'-0"	12'-3"	15'-4"	13'-10"	12'-1"	13'-3"	12'-6"	10'-11"
24	15'-4"	12'-3"	10'-8"	12'-6"	12'-1"	10'-6"	10'-10" <sup>e</sup>	10'-10" <sup>e</sup>	9'-7"

Non-Composite Table Notes:

- Heights are based on AISI S100-07 w/S2-10 Supplement, and AISI S100-12 Specification using steel properties alone.
- Compression flange must be continuously braced.
- End bearing must be 1 inch.
- The minimum overlap of the TSO (Outer Stud) and TSE (Inner Stud) must be 11 inches and must be connected with a minimum of (4) #8 x 9/16" long wafer head screws complying with ASTM C1513.
- e: Web stiffeners are required at the stud/track connection.

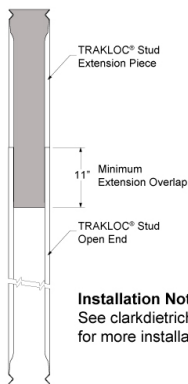

**Installation Notes:**  
 See [clarkdietrich.com/TRAKLOC](http://clarkdietrich.com/TRAKLOC)  
 for more installation procedures

Project Information	Contractor Information	Architect Information
Name:	Name:	Name:
Address:	Contact:	Contact:
	Phone:	Phone:
	Fax:	Fax: